


Installation Tips

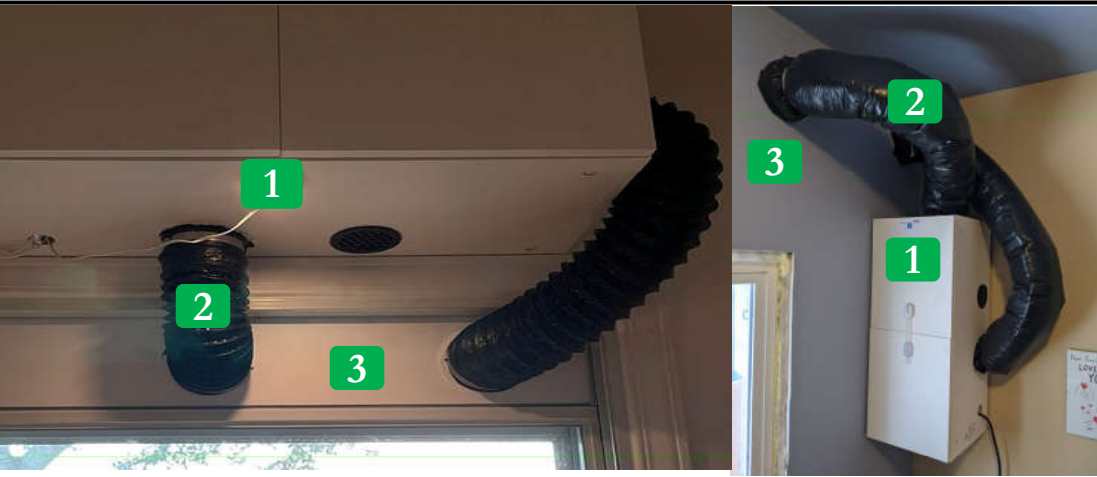

1 Unit Installation

The unit may be sited on a table / floor or mounted on a wall to save space. The unit may also be mounted on a ceiling.

2 Duct Insulation

The supply and exhaust ducts shall be insulated to minimize energy losses to the space.

3 Duct Installation

Window/Door

The ducts shall be inserted into two holes in either one or two boards.

- A pair of boards with each having one hole or a single board with two holes shall be fastened to a section of the window/door.
- A board may be fabricated by drilling two holes into a 1-inch thick insulation sheet or piece of wood.
- The edges of the board(s) shall be sealed.

Wall

The ducts shall be inserted into two holes that are drilled through the wall.

Note

The holes shall be 3 - 4 inch in diameter (insulation clearance may be added) and greater than 1 foot apart.